

Supplementary West Haven, CT Smoke Testing Area

October 2023

Smoke Testing Boundary



Sewer Network

Sewer

- Sewer Manhole
- Drop Manhole
- Interconnection Manhole
- Disabled Sewer Manhole

Water Pollution Control Facility




Pump Station



Sewer Main

- Main Sewer, 4 - 12"
- Main Sewer, 13 - 18"
- Main Sewer, 20 - 60"
- Force Main, 8 - 20"
- Main Sewer, Unknown Diam
- Lateral
- Abandoned Main
- Other

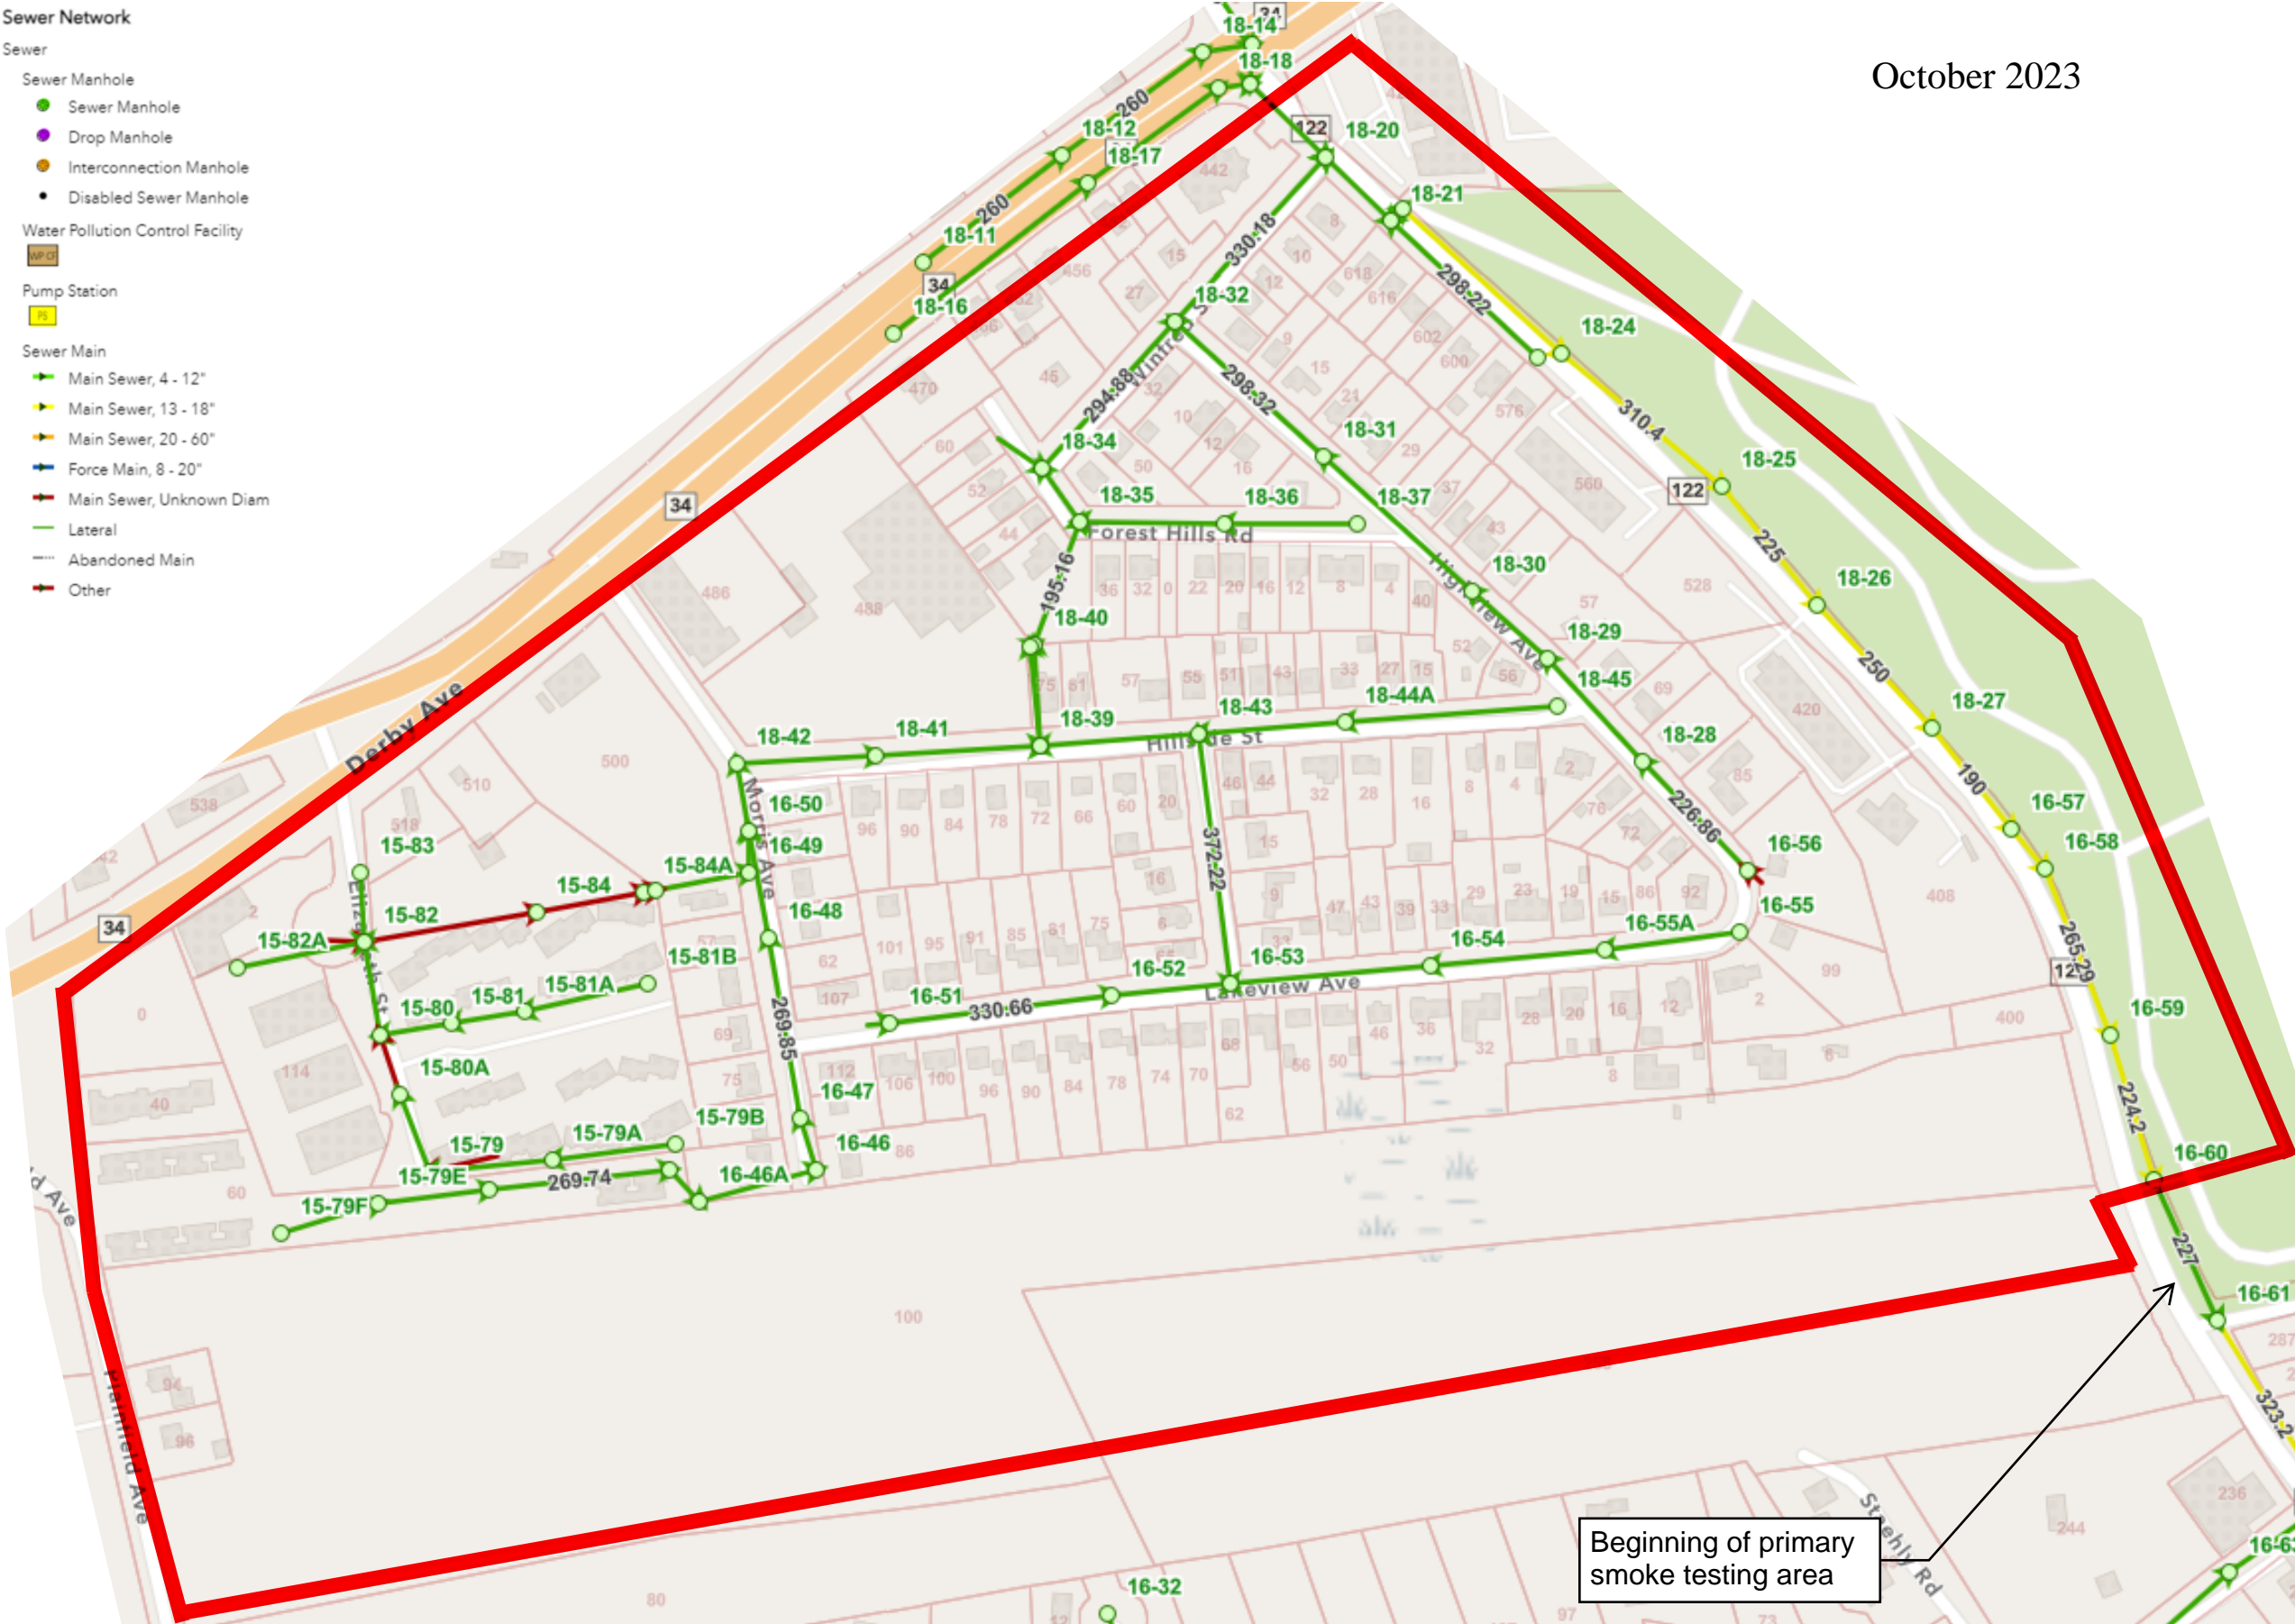

Beginning of primary
smoke testing area